

# Master Station Specification Sheet

## MASTER STATION A

## MASTER STATION B



<b>Order Code</b>	

<b>Backplane</b>	
1	19" or Panel
N	Not Required

<b>PSU</b>	
2	24 Vdc
1	Standard (Vac)
N	Not Required

<b>No of Field Units</b>	
	300 (only possible if P3 Wireless + P2 current loop selected )
5	
4	240
3	180
2	120
1	60
N	Not Required

<b>Option 1</b>	
4	Single channel Long Term Datalogger (alternate location 1)
3	Future Use
2	Future Use
1	P3 Wireless
0	Blank Box
N	Not Required

<b>Option 2</b>	
4	Single channel Long Term Datalogger (alternate location 2)
3	P2 Current loop
2	Future Use
1	Future Use
0	Blank Box
N	Not Required

<b>Switch Module</b>	
4	Future Use
3	Single channel Long Term Datalogger
2	H/S Key switch + Long Term Datalogger
1	Key Switch (replaced by LTD build - 2- since Q2 2011)
0	Blank Box
N	Not Required

<b>Option 2</b>	
4	Single channel Long Term Datalogger (alternate location 2)
3	P2 Current loop
2	Future Use
1	Future Use
0	Blank Box
N	Not Required


<b>No of Field Units</b>	
	300 (only possible if P3 Wireless + P2 current loop selected )
5	
4	240
3	180
2	120
1	60
0	Set to 0 for single channel <b>ONLY</b> – indicates requirement for DIN rail etc. to shopfloor
N	Not Required

<b>Option 1</b>	
4	Single channel Long Term Datalogger (alternate location 1)
3	Future Use
2	Future Use
1	P3 Wireless
0	Blank Box
N	Not Required

<b>PSU</b>	
2	24 Vdc
1	Standard (Vac)
N	Not Required

# Master Station Specification Sheet – Help Sheet

Please note: This specification sheet is designed to enable both complete master stations and spare parts for master stations to be configured / ordered.

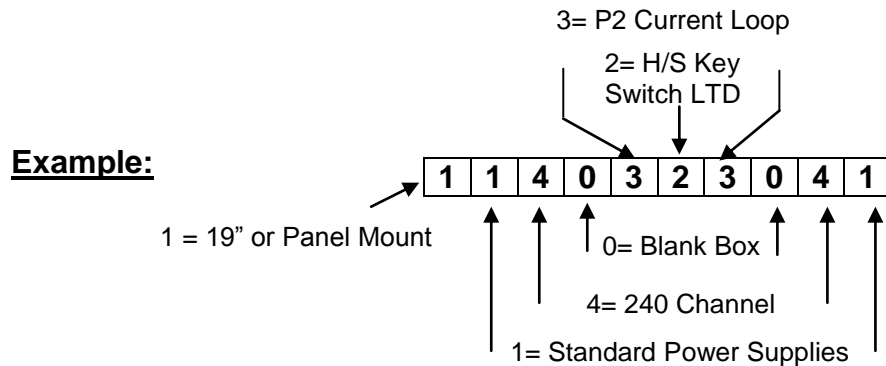

LTD – Long Term Datalogger

**Backplane:** Specifying ‘Not required’ (=N) for the backplane, means no backplane will be supplied. Any other items will be supplied loose, i.e. as spares. Specifying ‘Yes’ (=1) means the backplane will be supplied with both 19" Rack and Panel Mount fixtures.

**Power Supply:** The standard power supply is 87 to 265 Vac.

**Master Station:** Master Station comes preset for the maximum number of field units that may be connected. The option code specifies this size. If a single master station is configured the RHS module slots will be covered by a blanking plate and DIN rail

**Switch Module:** The Long Term Datalogger (LTD) is now the standard option for all Master Station configurations. For a Hot Standby Master Station specify this as 2, to include the LTD and the switch. For single master stations specify this as 3 to include only the LTD. For dual master stations place the LTD in the free option slot.

**Host Ports:** The Host Ports available as standard are 2 x RJ45 (10Base-T 100Base-Tx) Ethernet, (plus an additional Ethernet configuration port) and 2 x 9 way D- type serial ports which are switch selectable between RS485 or RS232.



PUB059-025-00\_1211

Date of issue: 12/2011

Page: 3 of 7

## Master Station Specification Sheet – Help Sheet

---

### **IMPORTANT WIRELESS NOTE:**

The code above selects the wireless master station mounted module (PS721), but not the wall mounted module that is also required. Therefore, please ensure that when a wireless option is selected for the master station, for each PS721 (master station mounted module) a PS722 module (the wall mounted wireless co-ordinator) is also configured as they are not automatically selected by the chosen code.

For example:

A single channel wireless master station will have 1 PS721 and therefore 1 PS722.

A hot standby wireless master station will have 2 PS721 and therefore 2 PS722.

## Master Station Specification Sheet – Help Sheet

---

### SPARES ORDERING INFORMATION

When ordering spares please use the module numbers referenced in the table:

Backplane (panel mount)	PS700
CPU (standard PSU) ①	PS710
CPU (dc PSU) ①	PS711
P2 Loop Driver	PS720
Key Switch (No Long Term Datalogger)	PS730
H/S Key Switch + Long Term Datalogger ②	PS731
Single Long Term Datalogger ②	PS732
Wireless Master Station Option Module (mounted to master station in an option slot)	PS721
Master Wireless Module (wall mounted wireless co-ordinator)	PS722

① Specify number of channels (Field Units)

② Due to compatibility issues, where an LTD is requested to be added to an existing P3 master station that did not have one fitted previously, the part number of the current loop module (s) PS720 must be checked. If the part number is 48465-03 or older then, along with the LTD, the spares kit must include one (or two for hot standby) replacement current loop modules.

PUB059-025 Appendix: Valid P3 Master Station order codes

<i>Single channel</i>	
Code	Description
<b>WIRED ONLY</b>	
111033NN0N	240AC, 60 field units, P2 loop
112033NN0N	240AC, 120 field units, P2 loop
113033NN0N	240AC, 180 field units, P2 loop
114033NN0N	240AC, 240 field units, P2 loop
121033NN0N	24DC, 60 field units, P2 loop
122033NN0N	24DC, 120 field units, P2 loop
123033NN0N	24DC, 180 field units, P2 loop
124033NN0N	24DC, 240 field units, P2 loop
<b>WIRELESS ONLY</b>	
111103NN0N	240AC, 60 field units, Wireless
121103NN0N	24DC, 60 field units, Wireless
<b>WIRED AND WIRELESS</b>	
112133NN0N	240AC, 120 field units, P2 loop and Wireless
113133NN0N	240AC, 180 field units, P2 loop and Wireless
114133NN0N	240AC, 240 field units, P2 loop and Wireless
115133NN0N	240AC, 300 field units, P2 loop and Wireless
122133NN0N	24DC, 120 field units, P2 loop and Wireless
123133NN0N	24DC, 180 field units, P2 loop and Wireless
124133NN0N	24DC, 240 field units, P2 loop and Wireless
125133NN0N	24DC, 300 field units, P2 loop and Wireless

**Note: The wireless master station modules can communicate to up to 60 wireless devices. For applications that require more that 60 wireless field units contact the systems department.**

PUB059-025 Appendix: Valid P3 Master Station order codes

<b>Hot standby</b>	
<b>Code</b>	<b>Description</b>
<b>WIRED ONLY</b>	
1110323011	240AC, 60 field units, P2 loop
1120323021	240AC, 120 field units, P2 loop
1130323031	240AC, 180 field units, P2 loop
1140323041	240AC, 240 field units, P2 loop
1210323012	24DC, 60 field units, P2 loop
1220323022	24DC, 120 field units, P2 loop
1230323032	24DC, 180 field units, P2 loop
1240323042	24DC, 240 field units, P2 loop
<b>WIRELESS ONLY</b>	
1111020111	240AC, 60 field units, Wireless
1211020112	24DC, 60 field units, Wireless
<b>WIRED AND WIRELESS</b>	
1121323121	240AC, 120 field units, P2 loop and Wireless
1131323131	240AC, 180 field units, P2 loop and Wireless
1141323141	240AC, 240 field units, P2 loop and Wireless
1151323151	240AC, 300 field units, P2 loop and Wireless
1221323122	24DC, 120 field units, P2 loop and Wireless
1231323132	24DC, 180 field units, P2 loop and Wireless
1241323142	24DC, 240 field units, P2 loop and Wireless
1251323152	24DC, 300 field units, P2 loop and Wireless

**Note: The wireless master station modules can communicate to up to 60 wireless devices. For applications that require more that 60 wireless field units contact the systems department.**

PUB059-025 Appendix: Valid P3 Master Station order codes

<b>Dual master station arrangement (this is not a common option)</b>	
<b>Code</b>	<b>Description</b>
<b>WIRED ONLY</b>	
1114303411	240AC, 60 field units, P2 loop
1124303421	240AC, 120 field units, P2 loop
1134303431	240AC, 180 field units, P2 loop
1144303441	240AC, 240 field units, P2 loop
1214303412	24DC, 60 field units, P2 loop
1224303422	24DC, 120 field units, P2 loop
1234303432	24DC, 180 field units, P2 loop
1244303442	24DC, 240 field units, P2 loop
<b>WIRELESS ONLY</b>	
1111404111	240AC, 60 field units, Wireless
1211404112	24DC, 60 field units, Wireless
<b>WIRED AND WIRELESS</b>	<b>NB: in this build there is no LTD as there is no room</b>
1121303121	240AC, 120 field units, P2 loop and Wireless
1131303131	240AC, 180 field units, P2 loop and Wireless
1141303141	240AC, 240 field units, P2 loop and Wireless
1151303151	240AC, 300 field units, P2 loop and Wireless
1221303122	24DC, 120 field units, P2 loop and Wireless
1231303132	24DC, 180 field units, P2 loop and Wireless
1241303142	24DC, 240 field units, P2 loop and Wireless
1251303152	24DC, 300 field units, P2 loop and Wireless

**Note: The wireless master station modules can communicate to up to 60 wireless devices. For applications that require more that 60 wireless field units contact the systems department.**